


13949

- (1) USE STANDARD MANHOLE FRAMES AND COVERS - SPEC. 11
- (2) USE STANDARD STRENGTH PIPE
- (3) USE CEMENT MORTAR FOR ALL VITRIFIED CLAY PIPE
- (4) RESURFACE ALL TRENCH WITHIN PAVED AREA TO MEET LOS ANGELES COUNTY ROAD DEPT. REQUIREMENTS IN ACCORDANCE WITH PERMIT
- (5) CONSTRUCT HOUSE CONNECTIONS WITH INVERT AT CITY BOUNDARY 5 FEET BELOW CURB GRADE
- (6) ALL STRUCTURES SHALL BE RECK STRUCTURES, S.A. 104
- (7) ENCASE FOUR FEET OF SEWER AT POINTS OF INTERFERENCE WITH POLES AS PER S-1-1-6
- (8) STOPPERS TO BE INSTALLED WITH JOINT COMPOUND BY MANUFACTURER AT HIS PLANT - SPEC'S SEC. 51-48
- (9) CONCRETE PAVEMENT TO BE CUT NOT LESS THAN 2" IN DEPTH WITH CONCRETE SAW - SPEC'S SEC. 05
- (10) WIRE AND TAGS TO BE INSTALLED - SPEC'S SEC. 18

DOUBLE
SCALE

INDEX MAP

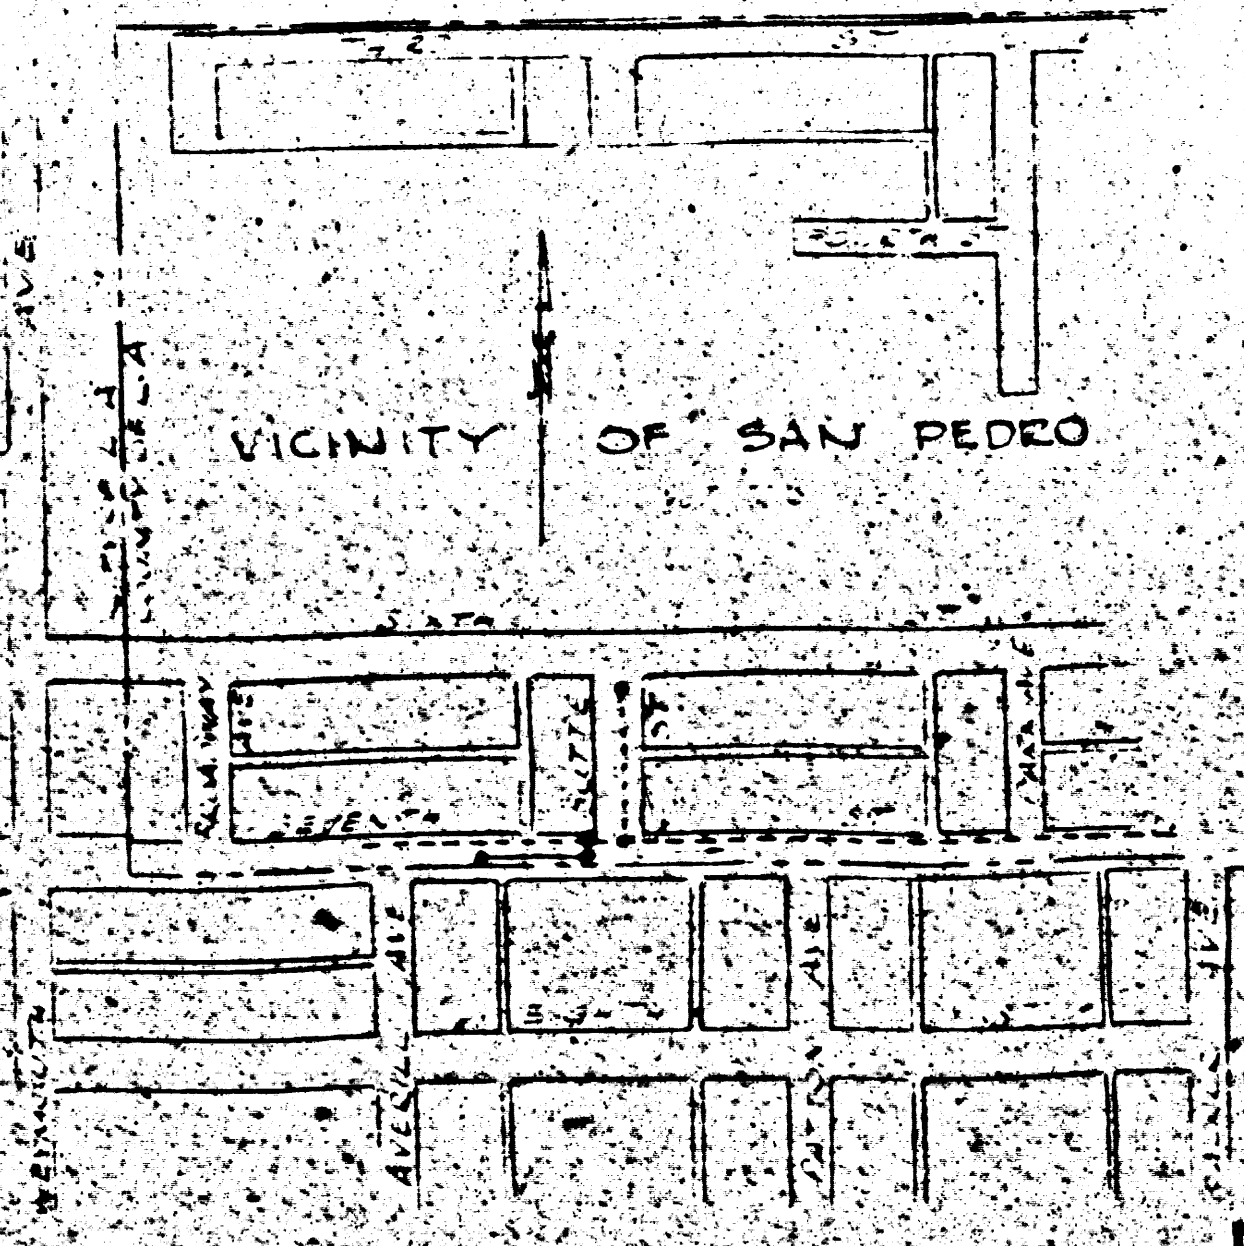

NOT TO BE USED FOR ANY OTHER PURPOSE WITHOUT THE WRITTEN PERMISSION OF THE ENGINEER. THIS DRAWING IS THE PROPERTY OF THE ENGINEER AND IS TO BE KEPT IN HIS OFFICE. IT IS TO BE RETURNED TO HIM UPON REQUEST. NO PART OF THIS DRAWING IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF THE ENGINEER.

94
95
96
97
98
99
100