

T.B.M. #1 El. 151.501, F.B. 1895 Pp. 03
 Bandini Blvd. (S. Side) 875'± W. of Atlantic Blvd.
 at S.W. corner of Freeway Ramp,
 Sp.K. in lead in curb 3' S. of S. end C.R.
 (Marked T.B.M. #1)

EAST LOS ANGELES BLDG. DIST. NO. 6

PC. 4481
 PAGE 1

COUNTY JOB NO. E. 0778.40

PROFILE, ALIGNMENT AND GRADE OF
SANITARY SEWERS
 TO BE CONSTRUCTED IN
BANDINI BOULEVARD
 AND DISTRICT NO. 6
PC-4481

25,502

SCALE: HORIZ. 1" = 40' VERT. 1" = 4' 0"

SEPTEMBER 1957

COUNTY OF LOS ANGELES, CALIFORNIA

JOHN A. LAMBIE COUNTY ENGINEER

SUBMITTED: *N.P. Brumby* ASSISTANT SANITATION ENGINEER
 APPROVED: *A.M. Rawm* COUNTY ENGINEER

A. M. RAWM
 COUNTY ENGINEER OF COUNTY OF LOS ANGELES DISTRICT NO. 6
 BY: *[Signature]* OFFICE ENGINEER

FOR LEGEND
 SEE PLAN NO. S-A-44

NOTE: GRADES TO WHICH THIS IMPROVEMENT IS TO BE CONSTRUCTED ARE SHOWN ON PLANS AND PROFILES. GRADE POINTS FOR TOP OF CURB, CENTER LINE OF STREET OR CENTER LINE OF ALLEY ARE SHOWN BY CIRCLES ON PROFILES. AT ALL POINTS BETWEEN ADJACENT POINTS THE GRADE SHALL BE ESTABLISHED SO AS TO CONFORM TO A STRAIGHT LINE DRAWN BETWEEN SAID DESIGNATED POINTS.


EXCEPTIONS ARE IN FOOT ABOVE IS. E. C. @ 0.5' B.S. LEVEL. EXCEPT FOR THESE EXCEPTIONS THE GRADE SHALL BE AS SHOWN ON THIS DRAWING AND SHALL BE SUBJECT TO THE APPROVAL OF THE COUNTY ENGINEER.

THE DRAWING AND THE DATA HEREON ARE HEREBY MADE A PART OF THE SPECIFICATIONS.

REFERENCES		
DESIGNED	KRIEGL	SEPT. 1957
TRACED	TEM	SEPT. 1957
CHECKED	KRIEGL	SEPT. 1957

W. S. 38
 A. B. 1849
 F. B. 1999

- USE [EXTRA] STRENGTH PIPE EXCEPT AS NOTED.
- USE CEMENT MORTAR FOR ALL VITRIFIED CLAY PIPE JOINTS.
- CONSTRUCT HOUSE LATERALS WITH INVERTS AT CURB OR PROPERTY LINE 7 FEET BELOW CURB GRADE, OR GRADE OF CENTER LINE OF STREET EXCEPT AS NOTED.
- CONSTRUCT HOUSE LATERALS WITH 1/4 INCH RISE PER FT. TO PROPERTY LINE, EXCEPT AS NOTED.
- ALL STRUCTURES SHALL BE BRICK SEWER STRUCTURES AS PER PLAN NO. S-A-104, EXCEPT AS NOTED.
- USE STANDARD MANHOLE FRAMES AND COVERS AS PER PLAN NO. S-A-117, EXCEPT AS NOTED.
- RESURFACE TRENCH WITHIN PAVED AREA WITH PREMIX ROCK AND OIL 3 INCHES IN THICKNESS 10% AGGREGATE BASE MATERIAL 6 INCHES IN THICKNESS.
- FIGURES IN CIRCLES AT ENDS OF HOUSE LATERALS INDICATE DEPTH BELOW CURB GRADE, OR GRADE OF CENTER LINE OF STREET.
- CONSTRUCTION IN STATE HIGHWAYS SHALL CONFORM WITH STATE HIGHWAY PERMITS.
- USE FORMULA NO. 1 SEC. 51 OF SPECIFICATIONS TO COMPUTE ALLOWABLE LEAKAGE.

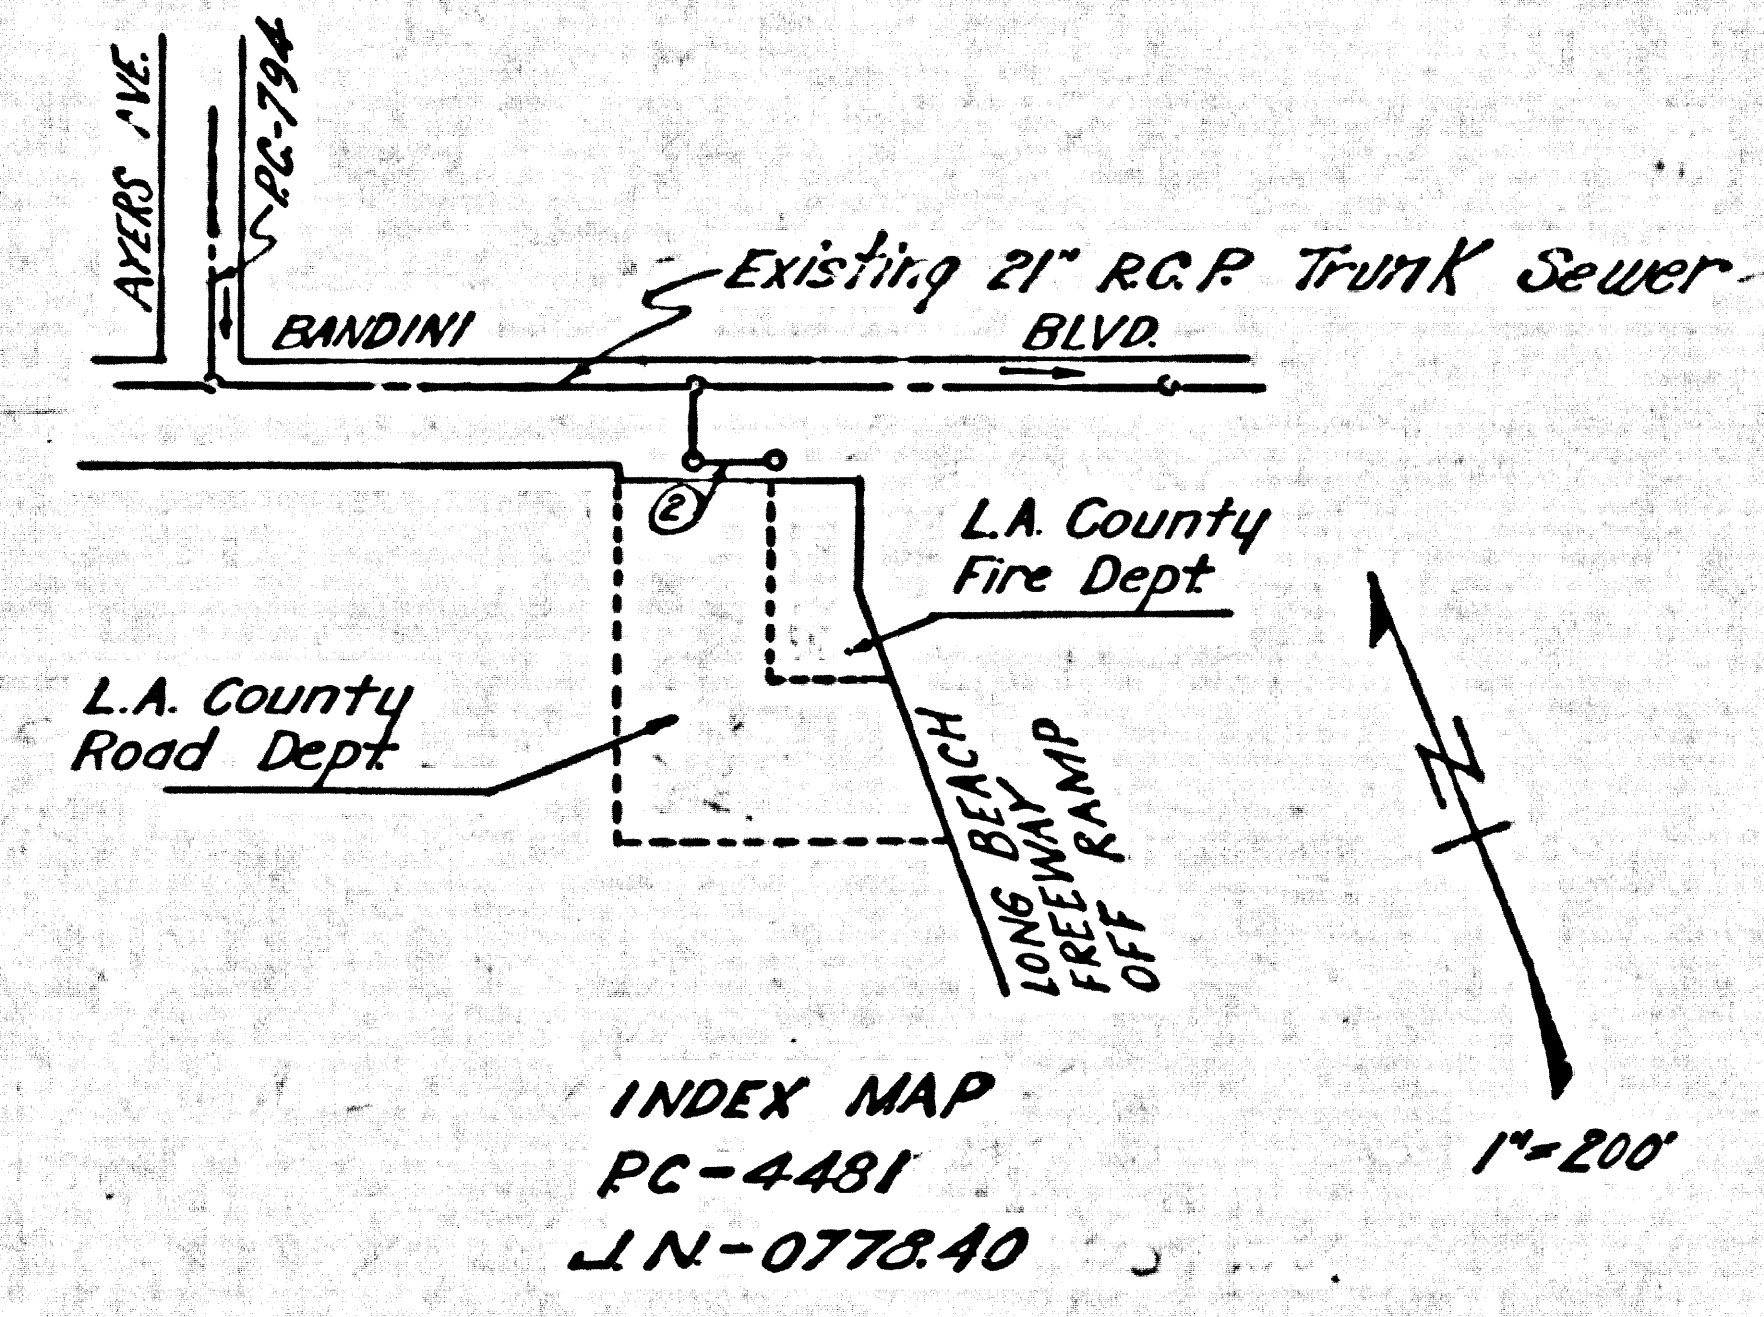

NO CHARGE FOR CONNECTIONS

INDEX MAP
 PC-4481
 LN-0778.40

1" = 200'

Before breaking into any existing street... and before final acceptance of this work, County Sanitation District should be notified in order that required inspection may be made.

PC. 4481
 PAGE 2

NO CHARGE FOR CONNECTIONS

25,503

