


B.M. 2379 ELEV. 62.969
 P.C. 27.477 51° S. ANGLE POINT WING WALL
 S.W. COR. BRIDGE 1477M. ON ALAMEDA STREET
 COMPTON CREEK 23' W. S. 600' S. ARTESIA
 BLVD.
 GARDENA QUAD. 19 65 ADJ.

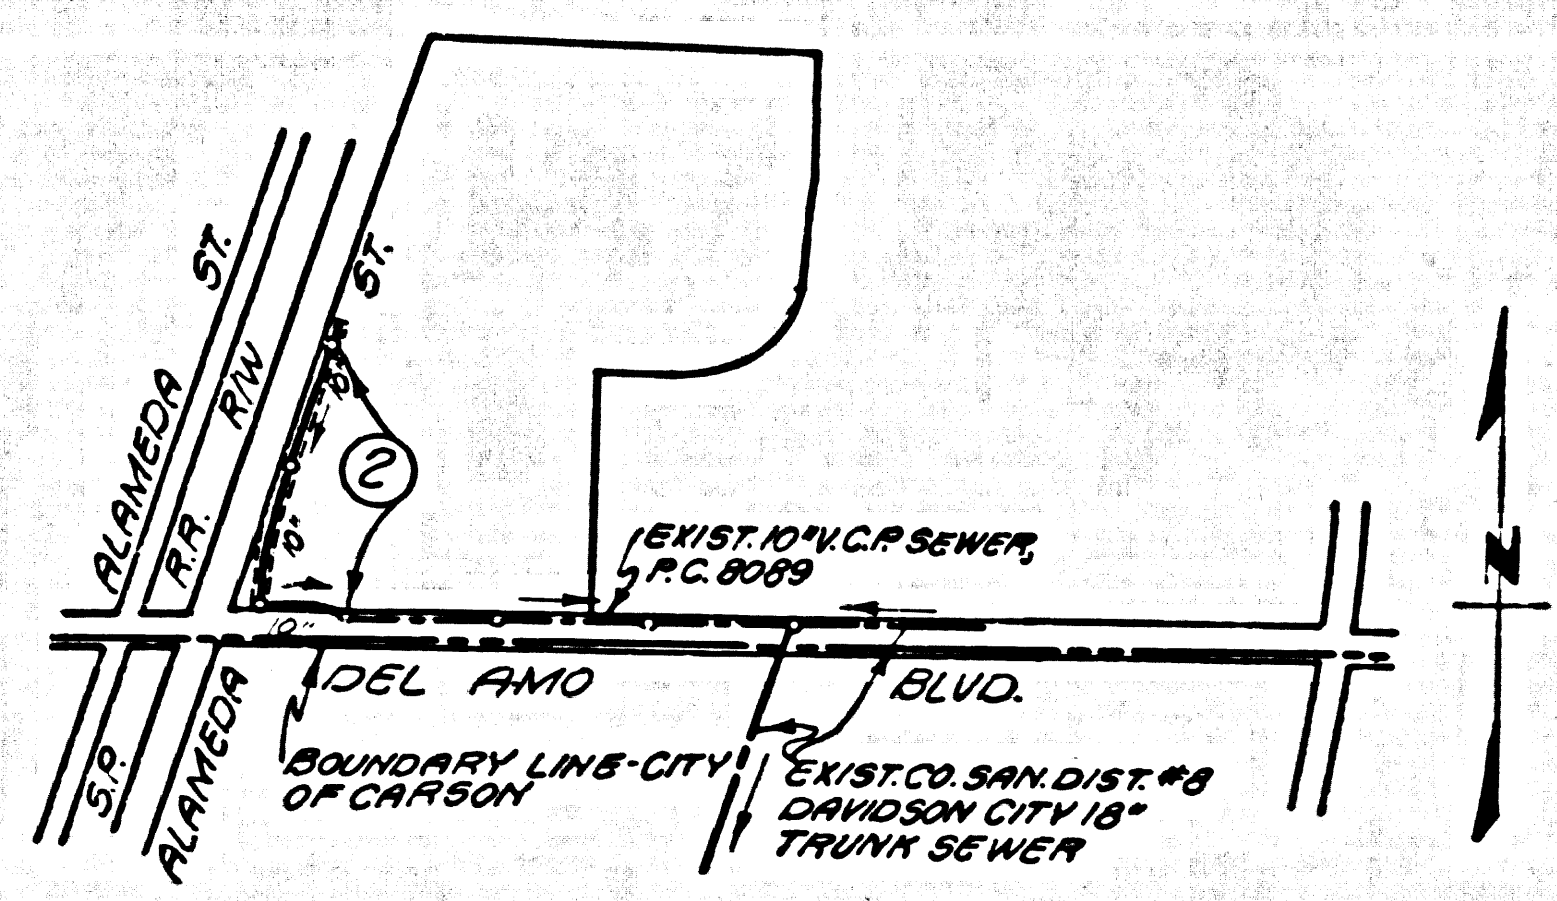

INDEX MAP
 P.C. 8569
 SCALE: 1"=600'

NOTE: PARCEL 1 OF P.M. No 2038 SERVED BY SEWER FROM EXISTING P.C. 8089.

THE FOLLOWING STANDARD PLANS ON FILE IN THE OFFICE OF THE COUNTY ENGINEER, SHALL APPLY IN THE CONSTRUCTION OF THIS PROJECT.

- LEGEND _____ S-1
- MIN. EXCAVATION SAFETY REQUIREMENTS _____ S-2
- BRICK MANHOLE _____ S-3
- NON REINFORCED PRECAST CONCRETE MANHOLE _____ S-36
- MANHOLE FRAME & COVER _____ S-35
- MANHOLE STEP _____ S-17
- BEDDING & SEWER PIPE _____ S-21
- CRADLING ENCASEMENT _____ S-23
- WYE & TEE SUPPORT _____ S-26
- ALLOWABLE TRENCH WIDTH _____ S-33

Revision #1
 Delete Encasement Sta. 8470 to Sta. 8700
 APPROVED *Robert Handke* 3/11/71

No connections for the disposal of industrial wastes shall be made to sewers shown on these drawings without written permission from the Chief Engineer and General Manager of the County Sanitation Districts.

County Sanitation Districts shall be notified prior to the following so that required inspection can be made (Phone 333-6666 - 638-1181)

Acceptance of the project.

DOMINGUEZ BLDG. DIST. NO. 13

- NOTES:
- PROFILES SHOWN ON THE PROPERTY LINE OR PROPERTY LINES PRODUCED AT RIGHT ANGLES TO THE SEWER LINE AT THE CENTER LINE OF EACH MANHOLE.
 - NO REPRESENTATIVE OF THE COUNTY ENGINEER ON LAY OUT ANY PORTION OF THE WORK.
 - THE PRIVATE ENGINEER SHALL FURNISH THE COUNTY ENGINEER WITH GRADE SHEETS AND STATIONINGS FOR ALL HOUSE LATERALS, "T" AND "Y" BRANCHES AND SHALL PROVIDE STAKES FOR THEM AT THEIR PROPER LOCATIONS WITH STATIONINGS PLAINLY MARKED. ALL HOUSE LATERALS SHALL BE CONSTRUCTED IN A STRAIGHT ALIGNMENT AT RIGHT ANGLES FROM THE MAIN LINE SEWER EXCEPT AS SHOWN ON THE PLANS. HOUSE LATERALS FROM CHIMNEYS SHALL NOT HAVE AN ANGLE OF LESS THAN 45° WITH THE MAIN LINE SEWER. ANY CHANGE IN ALIGNMENT SHALL BE REQUESTED IN WRITING BY THE PRIVATE ENGINEER.
 - THE PRIVATE ENGINEER SHALL FURNISH THE HOUSE LATERAL DEPTH AT THE PROPERTY LINE BELOW THE TOP OF CURB ELEVATION FOR EACH HOUSE LATERAL ON THE GRADE SHEET.
 - NO REVISIONS SHALL BE MADE IN THESE PLANS WITHOUT THE APPROVAL OF THE COUNTY ENGINEER.
 - THE CONTRACTOR SHALL NOTIFY THE CONSTRUCTION DIVISION BY TELEPHONE, MADISON 9-5707, EXT. 8188, AT LEAST TWENTY-FOUR HOURS BEFORE STARTING ANY WORK UNDER THIS CONTRACT.
 - ALL STRUCTURES SHALL BE SET TO THE SAME DEPTH PER S-3 OR PRECAST CONCRETE MANHOLES PER S-36 EXCEPT AS NOTED.
 - USE STANDARD MANHOLE FRAMES AND COVERS, P-36 EXCEPT AS NOTED.
 - MANHOLE TOPS IN UNIMPROVED RIGHTS-OF-WAY TO BE SIX INCHES ABOVE FINISHED GRADE.
 - USE STEEL STRENGTH PIPE. ALL PIPE IS STANDARD DEPTH EXCEPT AS NOTED.
 - INTERFERE CLAY PIPE JOINTS SHALL BE TYPE "B", "C" OR "D" PER STD. SPEC. 204-2.
 - IF A POWER POLE IS WITHIN THREE FEET OF THE SEWER, THE SEWER SHALL BE ENCASED, PER S-23, TWO FEET ON EACH SIDE FROM THE POINT OF INTERFERENCE.
 - IF DURING THE COURSE OF CONSTRUCTION IT IS DETERMINED THAT THERE IS LESS THAN FOUR FEET OF COVER OVER THE TOP OF A MAIN LINE OR HOUSE LATERAL V.C.P. SEWER WHICH IS NOT INDICATED ON THE PLANS, THE PIPE SHALL BE ENCASED PER S-23, UNLESS OTHERWISE APPROVED BY THE COUNTY ENGINEER.
 - HOUSE LATERALS TO BE CONSTRUCTED WITH INVERTS AT PROPERTY LINE AS NOTED.
 - RESURFACE ALL TRENCHES WITHIN PAVED AREAS TO MEET L.A. COUNTY ROAD DEPT. OR CALIFORNIA STATE HIGHWAY REQUIREMENTS IN ACCORDANCE WITH PERMITS.
 - SEWERS TO BE TESTED FOR LEAKAGE PER SECTION 204-3-7 STD. SPEC.
 - REFER TO SECTION 2-10-6-1 IN THE STD. SPEC'S REGARDING SAFETY DEVICES.
 - ALL JOINTS BETWEEN CAST IRON PIPE AND REINFORCED CLAY PIPE SHALL BE MADE WITH A RUBBER SLEEVES JOINT, TYPE "C" OR "D" (WITH BUSHING IF NECESSARY) PER STD. SPEC'S. 204-2.

COLLECT CHARGES AS INDICATED

NOTICE TO CONTRACTOR
 The existence and location of any underground utility pipes or structures shown on these plans are obtained by a search of the available records. To the best of my knowledge there are no existing utilities except as shown on these plans. The contractor is required to take due precautionary measures to protect the utility lines shown and any other lines not of record or not shown on these plans.
 Robert Handke 11/23/70
 C.E. NO. 10655

PROFILE ALIGNMENT AND GRADE OF P.C. 8569
 SANITARY SEWERS PAGE 1
 TO BE CONSTRUCTED IN

P.M. No 2038

PRIVATE CONTRACT NO. 8569

W.S. 32

1 SHEET 2 PAGES

SCALE: VERT. 1"=4' HORIZ. 1"=40'

NOVEMBER, 1970

PREPARED IN THE OFFICES OF E.L. PEARSON & ASSOCIATES

By Robert Handke 11/23/70
 REG. C. E. NO. 17062

42494

FOR LEGEND SEE PLAN NO. S-1

GRADES TO WHICH THIS IMPROVEMENT IS TO BE CONSTRUCTED ARE SHOWN ON PLANS AND PROFILES. GRADE POINTS FOR TOP OF CURBS, CENTER LINE OF STREETS, OR CENTER LINE OF ALLEYS ARE SHOWN BY CIRCLES ON PLANS. AT ALL POINTS BETWEEN DESIGNATED ELEVATIONS ARE IN FEET ABOVE U.S.C. & G.S. MEAN LEVEL DATUM OF 1929.

CONSTRUCTION SHALL BE CONSTRUCTED ACCORDING TO THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS, SANITARY SEWERS, EXCEPT WHERE SHOWN OTHERWISE. PROVISIONS FOR THE CONSTRUCTION OF SEWERS SHALL BE THE SAME AS FOR THE CONSTRUCTION OF SEWERS EXCEPT WHERE SHOWN OTHERWISE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL UTILITIES WHICH ARE LOCATED UNDER OR ADJACENT TO THE PROJECT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL UTILITIES WHICH ARE LOCATED UNDER OR ADJACENT TO THE PROJECT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL UTILITIES WHICH ARE LOCATED UNDER OR ADJACENT TO THE PROJECT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL UTILITIES WHICH ARE LOCATED UNDER OR ADJACENT TO THE PROJECT.

COUNTY OF LOS ANGELES, CALIFORNIA
 JOHN A. LAMBE, COUNTY ENGINEER
 J. D. PARKHURST, CHIEF ENGINEER
 CO. SAN. DIST. NO. 8
 APPROVED BY *Robert Handke* 11/23/70
 REG. C.E. NO. 10655

CHECKED BY *Robert Handke* 2/14/71
 REG. C.E. NO. 10655

