


- Notes For The Reconstruction of Sanitary Sewers**
1. Cast iron pipe shall be Class 150 minimum and shall be of a centrifugally cast type as specified in Section 207-91(c)(2) or Section 207-91(c)(3) of the Standard Specifications.
  2. The contractor shall maintain sewer service at all times during construction.
  3. All joints between cast iron pipe and vitrified clay pipe shall be made with a rubber sleeve joint, Type C or D (with bushing if necessary) per Standard Specifications Section 208-2.
  4. Sewer reconstruction work shall be constructed according to Standard Specifications for Public Works Construction (1970 Edition with 1971 Supplement) and County Engineer Special Provisions for the construction of sanitary sewers dated April 7, 1970 and shall be prosecuted only in the presence of the County Engineer.
  5. The contractor shall notify the Construction Division by telephone, Madison 9-4747, extension 81551, at least 24 hours before starting any work under this contract.

REVISIONS		
NO.	DATE	DESCRIPTION

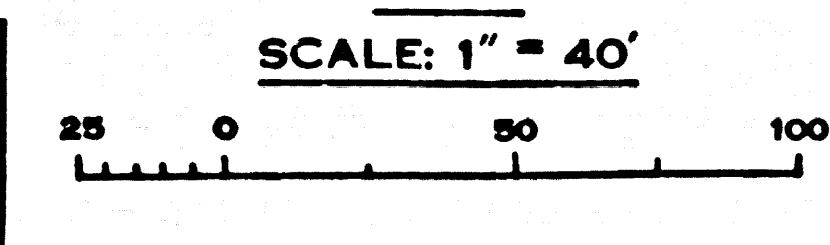

(REF.) P.C. 9070

W. 9. 32  
1970 STORM DRAIN BOND ISSUE

<p><b>CITY OF PARAMOUNT</b></p> <p>APPROVED: _____, 1971</p> <p>BY: <i>[Signature]</i> HARRY BOND, CITY MANAGER</p> <p>PREPARED UNDER THE DIRECTION OF <i>[Signature]</i> DAN W. NEIL, R.C.E. NO. 12588, DATE 7/23/71</p> <p><b>WILLDAN ENGINEERING</b> 125 SOUTH CLAUDINA STREET ANAHEIM, CALIFORNIA 92805 TELEPHONE (213) 460-7089</p>	<p><b>PARAMOUNT</b> PROJECT No. 6150</p> <p><b>PLAN AND PROFILE</b> STA. 22+00 TO STA. 30+60</p> <p>RECOMMENDED BY: _____ DATE: _____ SCALE AS SHOWN</p> <p>NO. _____ SHEET 5 OF 7</p>
--	--